

(Adopted September 9, 1988)(Amended January 6, 1989)  
(Amended May 13, 1994)(Amended June 16, 2000)  
(Amended November 17, 2000)([April 2, 2008](#))

**RULE 1146            EMISSIONS OF OXIDES OF NITROGEN FROM  
INDUSTRIAL, INSTITUTIONAL, AND COMMERCIAL  
BOILERS, STEAM GENERATORS, AND PROCESS  
HEATERS**

**(a)        Applicability**

This rule applies to boilers, steam generators, and process heaters of equal to or greater than 5 million Btu per hour rated heat input capacity and boilers, steam generators used in all industrial, institutional, and commercial operations with the exception of:

- (1)        boilers used by electric utilities to generate electricity; and
- (2)        boilers and process heaters with a rated heat input capacity greater than 40 million Btu per hour that are used in petroleum refineries; and
- (3)        sulfur plant reaction boilers.

**(ab)      Definitions**

- (1)        ANNUAL CAPACITY FACTOR means the ratio of the amount of fuel burned by a unit in a calendar year to the amount of fuel it could have burned if it had operated at the rated heat input capacity for 100 percent of the time during the calendar year.
- (2)        ANNUAL HEAT INPUT means the actual amount of heat released by fuels burned in a unit during a calendar year.
- (3)        BOILER or STEAM GENERATOR means any combustion equipment fired with liquid and/or gaseous and/or solid fossil fuel and used to produce steam or to heat water and that is not used exclusively to produce electricity for sale. Boiler or Steam Generator does not include any waste heat recovery boiler that is used to recover sensible heat from the exhaust of a combustion turbine or any unfired waste heat recovery boiler that is used to recover sensible heat from the exhaust of any combustion equipment.
- (4)        BTU means British thermal unit.
- (5)        GROUP I UNIT means any unit burning gaseous fuels with a rated heat input greater than or equal to 75 million Btu per hour.

- (6) GROUP II UNIT means any unit burning gaseous fuels, excluding digester and landfill gases, with a rated heat input less than 75 million Btu per hour down to and including 20 million Btu per hour.
- (7) GROUP III UNIT unit means any unit burning gaseous fuels, excluding digester and landfill gases, with a rated heat input less than 20 million Btu per hour down to and including 5 million Btu per hour, and all units operated at schools and universities greater than or equal to 5 million Btu per hour.
- (8) HEALTH FACILITY has the same meaning as defined in Section 1250 of the California Health and Safety Code.
- (59) HEAT INPUT means the chemical heat released due to fuel combustion in a unit, using the higher heating value of the fuel. This does not include the sensible heat of incoming combustion air.
- (610) NO<sub>x</sub> EMISSIONS means the sum of nitric oxide and nitrogen dioxide in the flue gas, collectively expressed as nitrogen dioxide.
- (711) PROCESS HEATER means any combustion equipment fired with liquid and/or gaseous and/or solid fossil fuel and which transfers heat from combustion gases to water or process streams. Process Heater does not include any kiln or oven used for drying, curing, baking, cooking, calcining, or vitrifying; or any unfired waste heat recovery heater that is used to recover sensible heat from the exhaust of any combustion equipment.
- (812) RATED HEAT INPUT CAPACITY means the heat input capacity specified on the nameplate of the combustion unit. If the combustion unit has been altered or modified such that its maximum heat input is different than the heat input capacity specified on the nameplate, the new maximum heat input shall be considered as the rated heat input capacity.
- (913) SCHOOL means any public or private school, including juvenile detention facilities with classrooms, used for purposes of the education of more than 12 children at the school, including in kindergarten and grades 1 to 12, inclusive, but does not include any private school in which education is primarily conducted in private homes. The term includes any building or structure, playground, athletic field, or other area of school property, but does not include unimproved school property.

(14) STANDBY BOILER is a boiler which operates as a temporary replacement for primary steam or hot water while the primary steam or hot water supply unit is out-of-service.

(4015) THERM means 100,000 Btu.

(4416) UNIT means any boiler, steam generator, or process heater as defined in paragraph (ab)(3) or (ab)(711) of this subdivision.

(b) Applicability

~~This rule applies to boilers, steam generators, and process heaters of equal to or greater than 5 million Btu per hour rated heat input capacity used in all industrial, institutional, and commercial operations with the exception of:~~

- ~~(1) boilers used by electric utilities to generate electricity; and~~
- ~~(2) boilers and process heaters with a rated heat input capacity greater than 40 million Btu per hour that are used in petroleum refineries; and~~
- ~~(3) sulfur plant reaction boilers.~~

(c) Requirements

(1) The owner or operator shall subject all of the units within the facility to the NOx emission limits and schedules specified in Table 1146-1:

Table 1146-1 – Standard Compliance Limits and Schedule

<u>Rule Reference</u>	<u>Category</u>	<u>Limit</u>	<u>Compliance Plan</u>	<u>Permit to Construct</u>	<u>Full Compliance</u>
<u>(c)(1)(A)</u>	<u>All Units Fired on Gaseous Fuels</u>	<u>30 ppm or 0.036 lbs/10<sup>6</sup> Btu</u>	<u>=</u>	<u>=</u>	<u>(date of adoption)</u>
<u>(c)(1)(B)</u>	<u>Any Units Fired on Non-gaseous Fuels</u>	<u>40 ppm</u>	<u>=</u>	<u>=</u>	<u>(date of adoption)</u>
<u>(c)(1)(C)</u>	<u>Any Units Fired on Landfill Gas</u>	<u>25 ppm</u>	<u>=</u>	<u>=</u>	<u>January 1, 2015</u>
<u>(c)(1)(D)</u>	<u>Any Units Fired on Digester Gas</u>	<u>15 ppm</u>	<u>=</u>	<u>=</u>	<u>January 1, 2015</u>
<u>(c)(1)(E)</u>	<u>Group I Units</u>	<u>5 ppm or 0.0062 lbs/10<sup>6</sup> Btu</u>	<u>=</u>	<u>January 1, 2012</u>	<u>January 1, 2013</u>
<u>(c)(1)(F)</u>	<u>Group II Units 75% or more of units (by heat input)</u>	<u>9 ppm or 0.011 lbs/10<sup>6</sup> Btu</u>	<u>January 1, 2010</u>	<u>January 1, 2011</u>	<u>January 1, 2012</u>
<u>(c)(1)(G)</u>	<u>Group II Units 100% of units (by heat input)</u>		<u>January 1, 2010</u>	<u>January 1, 2013</u>	<u>January 1, 2014</u>

Table 1146-1 – Standard Compliance Limits and Schedule (continued)

<u>Rule Reference</u>	<u>Category</u>	<u>Limit</u>	<u>Compliance Plan</u>	<u>Permit to Construct</u>	<u>Full Compliance</u>
(c)(1)(H)	Group III Units 75% or more of units (by heat input)	9 ppm or 0.011 lbs/10 <sup>6</sup> Btu	January 1, 2011	January 1, 2012	January 1, 2013
(c)(1)(I)	Group III Units 100% of units (by heat input)		January 1, 2011	January 1, 2014	January 1, 2015

(2) In lieu of complying with the NOx emission limits and schedules specified in paragraph (c)(1), the owner or operator may elect to subject all of the units within the facility to the requirements specified in Table 1146-2:

Table 1146-2 – Enhanced Compliance Limits and Schedule

<u>Rule Reference</u>	<u>Category</u>	<u>Limit</u>	<u>Compliance Plan</u>	<u>Permit to Construct</u>	<u>Full Compliance</u>
(c)(2)(A)	Group II Units 75% or more of units (by heat input)	5 ppm or 0.0062 lbs/10 <sup>6</sup> Btu	January 1, 2013	January 1, 2013	January 1, 2014
(c)(2)(B)	Group II Units 100% of units (by heat input)		January 1, 2013	January 1, 2015	January 1, 2016

- (1) ~~The owner or operator of any unit(s) with a rated heat input capacity greater than 40 million Btu per hour and with greater than 25% annual capacity factor burning gaseous and/or non-gaseous fuels, shall not discharge into the atmosphere NOx emissions, in excess of 30 ppm or 0.036 pound per 10<sup>6</sup> Btu of heat input.~~
- (2) ~~The owner or operator shall not discharge into the atmosphere NOx emissions in excess of 40 ppm or 0.052 pound per 10<sup>6</sup> Btu of heat input for any unit(s) with a rated heat input capacity:~~
  - (A) ~~greater than or equal to 5 million Btu per hour burning non-gaseous fuels, excluding units subject to (c)(1); or~~
  - (B) ~~greater than or equal to 5 million Btu per hour and less than 40 million Btu per hour burning gaseous or a combination of gaseous and non-gaseous fuels; or~~
  - (B) ~~greater than or equal to 40 million Btu per hour with a rated heat input less than or equal to 25 percent burning a gaseous or a combination of gaseous and non-gaseous fuels.~~

- (3) For dual fuel co-fired combustion a weighted average limit calculated by Equation 1146-1 may be used provided a totalizing fuel flow meter is installed pursuant to paragraph (c)(8), for units burning a combination of both fuels.

$$\text{Weighted Limit} = \frac{(CL_A \times Q_A) + (CL_B \times Q_B)}{Q_A + Q_B} \quad \text{Equation 1146-1}$$

Where:

CL<sub>A</sub> = compliance limit for fuel A

CL<sub>B</sub> = compliance limit for fuel B

Q<sub>A</sub> = heat input from fuel A

Q<sub>B</sub> = heat input from fuel B

~~On and after January 1, 2002, the owner or operator of any unit(s) with a rated heat input capacity greater than or equal to 10 million Btu per hour shall not discharge into the atmosphere NO<sub>x</sub> emissions in excess of:~~

~~(A) 30 ppm or 0.036 pound per 10<sup>6</sup> Btu of heat input for units burning gaseous fuels; or~~

~~(B) 30 ppm or 0.036 pound per 10<sup>6</sup> Btu of heat input, or a weighted average limit calculated using Equation 1, provided a totalizing fuel flow meter is installed pursuant to paragraph (c)(10), for units burning a combination of gaseous and non-gaseous fuels.~~

$$\text{Weighted Limit} = \frac{(30 \text{ ppmv} * x) + (40 \text{ ppmv} * y)}{x + y} \quad \text{Equation 1}$$

**Where:** ~~x~~ = annual heat input from gaseous fuel

~~y~~ = annual heat input from non-gaseous fuel

- (4) ~~On and after July 1, 2002, the owner or operator of any unit(s) with a rated heat input capacity greater than or equal to 5 million Btu per hour and less than 10 million Btu per hour, shall not discharge into the atmosphere NO<sub>x</sub>~~

~~emissions in excess of the emission limits specified in subparagraphs (e)(3)(A) and (e)(3)(B) as applicable.~~

- (4) In lieu of complying with the requirements specified in subparagraphs specified in Tables 1146-1 and 1146-2, the owner or operator of any unit may operate the unit in a manner that does not exceed the emission concentration limits specified in equation 1146-2 provided that such units are specified on the Permit to Operate.

$$\underline{CL_a = CL \times ECF}$$

Equation 1146-2

Where,

CL<sub>a</sub> is the adjusted concentration, ppm

CL is the concentration limit specified in subparagraphs (c)(1)(E) through (c)(1)(I) or paragraph (c)(2), ppm

ECF is the efficiency correction factor.

The ECF shall be 1.0 unless:

- (i) The unit's operator has measured the unit's specific efficiency (EF<sub>a</sub>), in compliance with ASME Performance Test Code PTC 4 – 1998, at the average firing rate of the unit; and
- (ii) The ECF-corrected emission limit is made a condition of the unit's Permit to Operate.

The ECF is calculated as follows:

$$\underline{ECF = \frac{[\text{Measured } EF_a, \%]}{[\text{Benchmark, \%}]}}$$

Equation 1146-3

ECF shall not be less than 1.0.

- (5) The owner or operator of any unit(s) with a heat input capacity greater than or equal to 5 million Btu per hour ~~and subject to (e)(1), (e)(2), (e)(3), or (e)(4)~~ shall not discharge into the atmosphere carbon monoxide (CO) emissions in excess of 400 ppm.
- (6) In lieu of complying with the applicable emission limits specified in paragraphs (c)(1), (c)(2), and (c)(3), ~~The owner or operator of any unit(s) in operation prior to (date of adoption) with a rated heat input capacity greater than or equal to 5 million Btu per hour and an annual heat input less than or equal to  $9.0 \times 10^9$  Btu (90,000 therms) per year, shall:~~
- (A) operate the unit(s) in a manner that maintains stack gas oxygen concentrations at less than or equal to 3 percent on a dry basis for any 15-consecutive-minute averaging period; or
  - (B) tune the unit(s) at least twice per year, (at intervals from 4 to 8 months apart) in accordance with the procedure described in Attachment 1 or the unit manufacturer's specified tune-up procedure. If a different tune-up procedure from that described in Attachment 1 is used then a copy of this procedure shall be kept on site. The operator of any unit(s) selecting the tune-up option shall maintain records for a rolling of twenty four month period verifying that the required tune-ups have been performed. If the unit does not operate throughout a continuous six-month period within a twelve month periodcalendar year, only one tuneup is required for the twelve month period that includes the entire period of non-operationthat calendar year. For this case, the tune-up shall be conducted within thirty (30) days of start-up. The operator of any unit(s) who specifies the tuneup option shall maintain a record for a period of two years verifying that the tuneup has been performed.—No tune-up is required during a rolling twelve month periodcalendar year for any unit that is not operated during that rolling twelve month periodcalendar year; this unit may be test fired to verify availability of the unit for its intended use but once the test firing is completed the unit shall be shutdown. Records of test firings shall be maintained for a rolling twenty four month periodof two years, and shall be made accessible to an authorized District representative upon request; or meet the applicable NOx

~~and CO emission limits in paragraphs (c)(1), (c)(2), (c)(3), and (c)(4), and (c)(5).~~

- ~~(7) The owner or operator of any unit(s) subject to paragraph (c)(6) shall submit for the approval of the Executive Officer a compliance plan that demonstrates compliance with paragraph (c)(6). Such plan shall contain:~~
- ~~(A) A list of permits of all units with the rated heat input capacity and anticipated annual heat input.~~
  - ~~(B) For each unit listed, a selection of one of the three options specified in paragraph (c)(6) to achieve compliance with this rule.~~
  - ~~(C) Nonresettable fuel totalizing meter specifications for each fuel used, date of meter installation, records of fuel use for each unit during the last two years starting from March 1, 1991.~~

~~The plan shall be disapproved if for any continuous 12 month period, the annual fuel usage exceeds 90,000 therms. In this case the unit shall have to comply with the applicable emission limits specified in paragraphs (c)(1), (c)(2), (c)(3), or (c)(4).~~

- ~~(87) Any unit(s) with a rated heat input capacity greater than or equal to 40 million Btu per hour and an annual heat input greater than  $200 \times 10^9$  Btu per year shall have a continuous in-stack nitrogen oxides monitor or equivalent verification system in compliance with 40 CFR part 60 Appendix B Specification 2. Maintenance and emission records shall be maintained and made accessible for a period of two years as to the Executive Officer.~~
- ~~(9) For owners or operators that are subject to the requirements specified in paragraph (c)(6), the provisions of paragraphs (c)(1), (c)(2), (c)(3), (c)(4), (c)(5), or (c)(8), as applicable, shall become effective for the life of the unit on March 1 of any calendar year if that unit operated for the previous calendar year at an annual heat input greater than:~~
- ~~(A) 90,000 therms for units greater than or equal to 5 million Btu per hour; or~~
  - ~~(B)  $200 \times 10^9$  Btu per year for units greater than or equal to 40 million Btu per hour.~~

(98) An owner or operator that has installed or modified a Group III natural gas fired unit prior to the (date of adoption) complying with the applicable BACT emission limit of 12 ppm or less of NOx may defer compliance with subparagraphs (c)(1)(H) or (c)(1)(I) for 15 years from the date the unit's burner(s) was installed or modified.

(109) Any owner or operator who chooses the pound per million Btu compliance option specified in paragraph(s) (c)(1) or, (c)(2), ~~(e)(3), or (e)(4)~~ or chooses the weighted average emission limit using Equation 1146-1 under ~~sub~~paragraph (c)(3) shall install a non-resettable totalizing fuel meter to measure the total of each fuel used by each individual unit, as approved by the Executive Officer.

~~(11) Any owner or operator of a unit not covered under the provisions of paragraphs (e)(1), (e)(2), (e)(3), (e)(4), or (e)(8) based on annual heat input, shall:~~

~~(A) have installed by February 1, 1989 for units with a rated heat input capacity equal to or greater than 5 but less than 40 million Btu per hour, or by May 1, 1989 for units with a rated heat input capacity equal to or greater than 40 million Btu per hour, or at the time the unit is constructed, a totalizing meter for each fuel that demonstrates that the unit(s) operated at or below the applicable heat input levels; and~~

~~(B) have available for inspection by the Executive Officer by March 1 of each year, records listing cumulative annual usage of each fuel for the preceding calendar year. Records shall be maintained and made accessible to the Executive Officer for a period of two years; and~~

~~(C) demonstrate that the annual heat input is less than or equal to the applicable amount listed in the applicable paragraphs (e)(1), (e)(2), (e)(3), (e)(4), and/or (e)(8).~~

(10) The owner or operator of Group II or III units shall submit for the approval of the Executive Officer a compliance plan according the appropriate schedule specified in Tables 1146-1 or 1146-2. The compliance plan shall include the following information:

(A) Owner/operator contact information (company name, AQMD facility identification number, contact name, phone number, address, e-mail address).

- (B) Number and size (mmbtu/hr) of Group II and III units located at the facility.
- (C) Selection of the Standard (Table 1146-1) or Enhanced (Table 1146-2) compliance schedule by Group II and III units.
- (D) The owner or operator of more than one unit located within the same facility that have opted to divide the units by heat input for the purpose of separate compliance dates according to Tables 1146-1 or 1146-2 shall indicate which units are categorized 75 percent or more of the heat input and which units make up the remaining 100 percent of the heat input.

(d) Compliance Determination

- (1) An owner or operator of any unit(s) shall have the option of complying with either the pound per million Btu or parts per million emission limits specified in paragraphs (c)(1), ~~(c)(2)~~, and (c)(8)~~(e)(3), and (e)(4)~~.
- (2) All emission determinations shall be made in the as-found operating condition, except no compliance determination shall be established during start-up, shutdown, or under breakdown conditions. An emission determination shall be conducted at least 250 operating hours, or at least thirty days subsequent to the tuning or servicing of any unit, unless it is an unscheduled repair.
- (3) All parts per million emission limits specified in ~~subdivision~~ paragraph (c) are referenced at 3 percent volume stack gas oxygen on a dry basis averaged over a period of 15 consecutive minutes.
- (4) Initial Compliance—compliance with the NO<sub>x</sub> and CO emission requirements of paragraphs (c)(1), (c)(2), (c)(3), (c)(4), ~~and (c)(5)~~, and (c)(8) and the stack-gas oxygen concentration requirement of subparagraph (c)(6)(A) shall be determined according to the following procedures:
  - (A) ~~in~~ District Source Test Method 100.1 - Instrumental Analyzer Procedures for Continuous Gaseous Emission Sampling (March 1989), or
  - (B) District Source Test Method 7.1 - Determination of Nitrogen Oxide Emissions from Stationary Sources (March 1989) and District Source Test Method 10.1 - Carbon Monoxide and Carbon Dioxide by Gas Chromatograph/Non-Dispersive Infrared Detector

(GC/NDIR) - Oxygen by Gas Chromatograph-Thermal Conductivity (GC/TCD) (March 1989); or

(C) United States Environmental Protection Agency Conditional Test Method CTM-030, Determination of Nitrogen Oxides, Carbon Monoxide, and Oxygen Emissions from Natural Gas-Fired Engines, Boilers and Process Heaters Using Portable Analyzers; or

(D) ASTM D6522-00(2005) Standard Test Method for Determination of Nitrogen Oxides, Carbon Monoxide, and Oxygen Concentrations in Emissions from Natural Gas-Fired Reciprocating Engines, Combustion Turbines, Boilers, and Process Heaters Using Portable Analyzers

(E) any other test method, ~~such as methods that allow the use of hand-held portable monitors,~~ determined to be alternative equivalent and approved before the test in writing by the Executive Officers of the District and the California Air Resources Board and the Regional Administrator of the United States Environmental Protection Agency, Region IX; ~~or~~

(F) a continuous in-stack nitrogen oxide monitor or equivalent verification system as specified in paragraph (c)(7).

Records of all source tests shall be ~~maintained for a period of two years and shall be~~ made available to District personnel upon request. Emissions determined to exceed any limits established by this rule through the use of any of the above-referenced test methods shall constitute a violation of this rule.

(5) For any operator who chooses the pound per million Btu of heat input compliance option of paragraph (c)(1), (c)(2), or (c)(8)~~(e)(3), or (e)(4),~~ NO<sub>x</sub> emissions in pounds per million Btu of heat input shall be calculated using procedures in 40 CFR Part 60, Appendix A, Method 19, Sections 2 and 3.

(6) Compliance determination with the NO<sub>x</sub> and CO emission requirements in paragraph (d)(4) shall be conducted once:

(A) every three years for units with a rated heat input less than 40 Btu per hour down to and including 10 million Btu per hour. ~~or before January 1, 2002 and every year thereafter for units with a rated heat input capacity equal to or greater than 10 million Btu per hour and on or before July 1, 2002 and every year thereafter for units~~

~~with a rated heat input capacity less than 10 million Btu per hour. Notwithstanding the requirements of paragraph (d)(2), for the purposes of demonstrating compliance with the annual compliance determination, an owner or operator may tune a unit prior to conducting emissions testing. Any screening analysis while tuning the unit shall not be considered an emissions test for the annual compliance determination.~~

(B) every five years for units with a rated heat input less than 10 Btu per hour down to and including 5 million Btu per hour.

(7) Provided the emissions test is conducted within the same calendar year as the test required in paragraph (d)(6), an owner or operator may use the following emissions tests to comply with paragraph (d)(6):

(A) Periodic monitoring or testing of a unit as required in a Title V permit pursuant to Regulation XXX, or

(B) Relative accuracy testing for continuous emissions monitoring verification pursuant to Rule 218.1.

(8) Any owner or operator shall check emissions with a portable NOx, CO and oxygen analyzer according to the Protocol for the Periodic Monitoring of Nitrogen Oxides, Carbon Monoxide, and Oxygen from Units Subject to South Coast Air Quality Management District Rules 1146 and 1146.1 at least monthly or every 750 unit operating hours, whichever occurs later. If a unit is in compliance for three consecutive emission checks, without any adjustments to the oxygen sensor set points, then the engine may be checked quarterly or every 2,000 unit operating hours, whichever occurs later, until there is a noncompliant emission check.

Records of all monitoring data shall be maintained for a rolling twelve month period of two years and shall be made available to District personnel upon request. An owner or operator shall not be considered in violation of the emissions limits of this rule or in permit conditions if the owner or operator complies with requirements specified in paragraph (d)(9). Any emission check conducted by District staff that finds excess emissions is a violation.

(9) A source test specified under paragraph (d)(6) or an emission check conducted under the requirements specified in paragraph (d)(8) that finds emissions in excess of those allowed by this rule or a permit condition, the owner or operator shall correct the problem and demonstrate compliance

with another source test or emission check, or shut down the unit by the end of an operating cycle, or within 72 hours from the time the owner or operator knew of excess emissions, or reasonably should have known, whichever is sooner.

(e) Compliance Schedule

- (1) An owner or operator of units subject to paragraph (c)(1) shall comply with the schedule specified in Table 1146-1.
- (2) An owner or operator of units subject to paragraph (c)(2) shall comply with the schedule specified in Table 1146-2.
- (3) An owner or operator may opt to lower the unit's rated heat input capacity prior to the dates specified below.
  - (A) For units subject to subparagraphs (c)(1)(F), (c)(1)(G), (c)(2)(A), or (c)(2)(B) – July 1, 2010.
  - (B) For units subject to subparagraphs (c)(1)(E), (c)(1)(H), (c)(1)(I) – July 1, 2011.

The lower rated heat input capacity shall be based on manufacturer's identification or rating plate or permit condition.

- (4) On or after January 1, 2015 or during burner replacement, whichever occurs later, no person shall operate in the District any unit subject to paragraph (c)(6) which does not meet the emissions limits specified in subparagraph (c)(1)(A) of Table 1146-1.
- (5) Any unit subject to the requirements specified in paragraph (c)(6) that exceeds 90,000 therms of heat input from all fuels used in any twelve month period, the operators shall:
  - (A) within 4 months after exceeding 90,000 therms of heat input in any twelve month period, submit required applications for permits to construct and operate; and
  - (B) within 18 months after exceeding 90,000 therms of heat input in any twelve month period, demonstrate and maintain compliance with all applicable requirements of paragraphs (c)(1), (c)(2), (c)(3), (c)(4), (c)(7), and (c)(9) for the life of the unit.
- (6) The Executive Officer shall grant a time extension to the full compliance date with the applicable NOx compliance limits specified in subparagraphs (c)(1)(F) through (c)(1)(I) and paragraph (c)(2) for any health facility as defined in Section 1250 of the California Health and

Safety Code that can demonstrate that the Office of Statewide Health Planning and Development has approved an extension of time to comply with seismic safety requirements pursuant to Health and Safety Code Sections 130060 and 130061.5. The extension of time granted by the Executive Officer shall be consistent with the time extension granted pursuant to Health and Safety Code Section 130060 but not to exceed January 1, 2015 and shall be consistent with the time extension granted pursuant to Health and Safety Code Section 130061.5 but not to exceed January 1, 2020. Those health facilities granted a time extension shall submit a compliance plan to the Executive Officer on or before January 1, 2010.

(e) **Exemption**

~~A one time exemption from the requirements of paragraphs (c)(1), (c)(2), (c)(3), (c)(4), (c)(8) and (c)(12) is allowed for any owner or operator of a standby boiler whose fuel usage from all fuels exceeded 90,000 therms but was not greater than 110,000 therms of annual heat input during the calendar year 1996. As a condition of this exemption, an owner or operator shall submit an application for a permit modification by July 31, 2000 and accept additional permit conditions that provide for a daily emission increase, above what is allowed under paragraph (c)(1), (c)(2), (c)(3), and (c)(4) of less than 55 pounds per day of NO<sub>x</sub> for all standby boilers subject to this subdivision, an annual heat input of less than 90,000 therms for each standby boiler, and a daily recordkeeping condition.~~

**ATTACHMENT 1**

**A. Equipment Tuning Procedure<sup>1</sup> for Forced-Draft Boilers, Steam Generators, and Process Heaters**

Nothing in this Equipment Tuning Procedure shall be construed to require any act or omission that would result in unsafe conditions or would be in violation of any regulation or requirement established by Factory Mutual, Industrial Risk Insurers, National Fire Prevention Association, the California Department of Industrial Relations (Occupational Safety and Health Division), the Federal Occupational Safety and Health Administration, or other relevant regulations and requirements.

Should a different tuning procedure be used, a copy of this procedure should be kept with the unit records for two years and made available to the District personnel on request.

1. Operate the unit at the firing rate most typical of normal operation. If the unit experiences significant load variations during normal operation, operate it at its average firing rate.
2. At this firing rate, record stack gas temperature, oxygen concentration, and CO concentration (for gaseous fuels) or smoke-spot number<sup>2</sup> (for liquid fuels), and observe flame conditions after unit operation stabilizes at the firing rate selected. If the excess oxygen in the stack gas is at the lower end of the range of typical minimum values<sup>3</sup>, and if CO emissions are low and there is not smoke, the unit is probably operating at near optimum efficiency - at this particular firing rate.

However, complete the remaining portion of this procedure to determine whether still lower oxygen levels are practical.

3. Increase combustion air flow to the furnace until stack gas oxygen levels increase by one to two percent over the level measured in Step 2. As in Step 2, record the

---


<sup>1</sup> This tuning procedure is based on a tune-up procedure developed by KVB, Inc. for the United States EPA.

<sup>2</sup> The smoke-spot number can be determined with ASTM Test Method D-2156 or with the Bacharach method. ASTM Test Method D-2156 is included in a tuneup kit that can be purchased from the Bacharach Company.


<sup>3</sup> Typical minimum oxygen levels for boilers at high firing rates are:

1. For natural gas: 0.5% - 3%
2. For liquid fuels: 2% - 4%

- stack gas temperature, CO concentration (for gaseous fuels) or smoke-spot number (for liquid fuels), and observe flame conditions for these higher oxygen levels after boiler operation stabilizes.
4. Decrease combustion air flow until the stack gas oxygen concentration is at the level measured in Step 2. From this level gradually reduce the combustion air flow, in small increments. After each increment, record the stack gas temperature, oxygen concentration, CO concentration (for gaseous fuels) and smoke-spot number (for liquid fuels). Also observe the flame and record any changes in its condition.
  5. Continue to reduce combustion air flow stepwise, until one of these limits is reached:
    - a. Unacceptable flame conditions - such as flame impingement on furnace walls or burner parts, excessive flame carryover, or flame instability.
    - b. Stack gas CO concentrations greater than 400 ppm.
    - c. Smoking at the stack.
    - d. Equipment-related limitations - such as low windbox/furnace pressure differential, built in air-flow limits, etc.
  6. Develop an O<sub>2</sub>/CO curve (for gaseous fuels) or O<sub>2</sub>/smoke curve (for liquid fuels) similar to those shown in Figures 1 and 2 using the excess oxygen and CO or smoke-spot number data obtained at each combustion air flow setting.

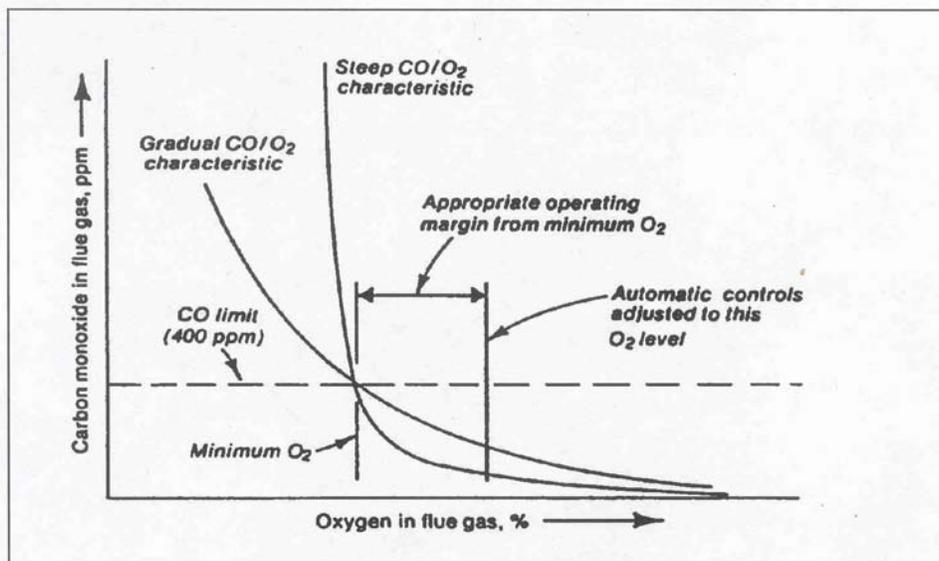

**Figure 1** Oxygen/CO Characteristic Curve

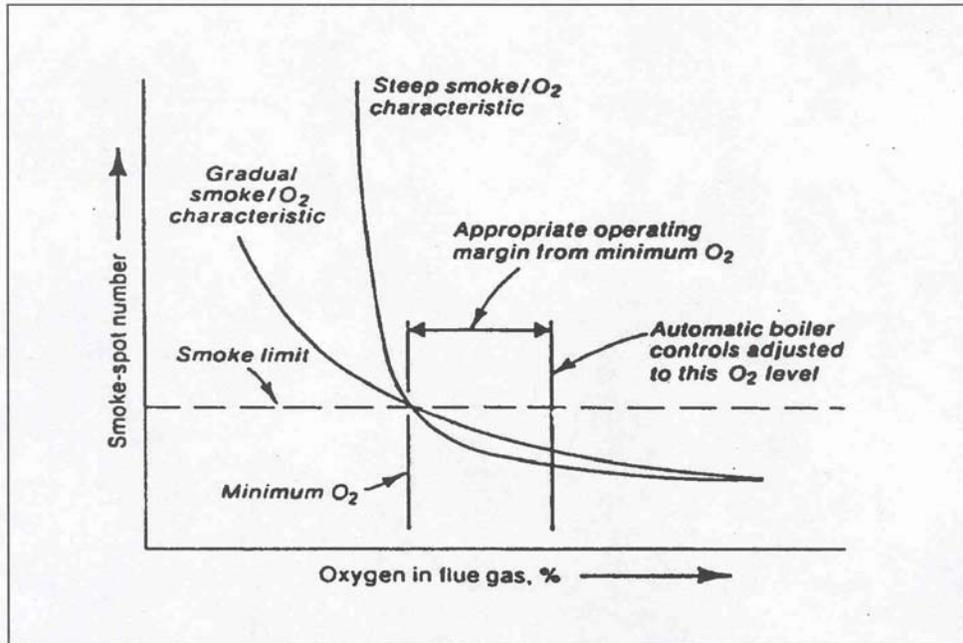

**Figure 2** Oxygen/Smoke Characteristic Curve

7. From the curves prepared in Step 6, find the stack gas oxygen levels where the CO emissions or smoke-spot number equal the following values:

<u>Fuel</u>	<u>Measurement</u>	<u>Value</u>
Gaseous	CO Emissions	400 ppm
#1 and #2 oils	smoke-spot number	number 1
#4 oil	smoke-spot number	number 2
#5 oil	smoke-spot number	number 3
Other oils	smoke-spot number	number 4

The above conditions are referred to as the CO or smoke thresholds, or as the minimum excess oxygen level.

Compare this minimum value of excess oxygen to the expected value provided by the combustion unit manufacturer. If the minimum level found is substantially higher than the value provided by the combustion unit manufacturer, burner adjustments can probably be made to improve fuel and air mixing, thereby allowing operation with less air.

8. Add 0.5 to 2.0 percent ~~of O<sub>2</sub>~~ to the minimum excess oxygen level found in Step 7 and reset burner controls to operate automatically at this higher stack gas oxygen level. This margin above the minimum oxygen level accounts for fuel variations, variations in atmospheric conditions, load changes, and nonrepeatability or play in automatic controls.

9. If the load of the combustion unit varies significantly during normal operation, repeat Steps 1-8 for firing rates that represent the upper and lower limits of the range of the load. Because control adjustments at one firing rate may affect conditions at other firing rates, it may not be possible to establish the optimum excess oxygen level at all firing rates. If this is the case, choose the burner control settings that give best performance over the range of firing rates. If one firing rate predominates, settings should optimize conditions at that rate.
10. Verify that the new settings can accommodate the sudden load changes that may occur in daily operation without adverse effects. Do this by increasing and decreasing load rapidly while observing the flame and stack. If any of the conditions in Step 5 result, reset the combustion controls to provide a slightly higher level of excess oxygen at the affected firing rates. Next, verify these new settings in a similar fashion. Then make sure that the final control settings are recorded at steady-state operating conditions for future reference.
11. When the above checks and adjustments have been made, record data and attach combustion analysis data to boiler, steam generator, or heater records indicating name and signature of person, title, and date the tuneup was performed.

**B. Equipment Tuning Procedure for Natural Draft-Fired Boilers, Steam Generators, and Process Heaters.**

Nothing in this Equipment Tuning Procedure shall be construed to require any act or omission that would result in unsafe conditions or would be in violation of any regulation or requirement established by Factory Mutual, Industrial Risk Insurers, National Fire Prevention Association, the California Department of Industrial Relations (Occupational Safety and Health Division), the Federal Occupational Safety and Health Administration, or other relevant codes, regulations, and equipment manufacturers specifications and operating manuals.

Should a different tuning procedure be used, a copy of this procedure should be kept with the unit records for two years and made available to the District personnel on request.

1. **PRELIMINARY ANALYSIS**
  - a. **CHECK THE OPERATING PRESSURE OR TEMPERATURE.**

Operate the boiler, steam generator, or heater at the lowest acceptable pressure or temperature that will satisfy the load demand. This will minimize heat and radiation losses. Determine the pressure or temperature

that will be used as a basis for comparative combustion analysis before and after tuneup.

b. CHECK OPERATING HOURS.

Plan the workload so that the boiler, steam generator, or process heater operates only the minimum hours and days necessary to perform the work required. Fewer operating hours will reduce fuel use and emissions. For units requiring a tuneup to comply with the rule, a totalizing non-resettable fuel meter will be required for each fuel used and for each boiler, steam generator, and heater to prove fuel consumption is less than the heat input limit in therms per year specified in the rule.

c. CHECK AIR SUPPLY.

Sufficient fresh air supply is essential to ensure optimum combustion and the area of air supply openings must be in compliance with applicable codes and regulations. Air openings must be kept wide open when the burner is firing and clear from restriction to flow.

d. CHECK VENT.

Proper venting is essential to assure efficient combustion. Insufficient draft or overdraft promotes hazards and inefficient burning. Check to be sure that vent is in good condition, sized properly and with no obstructions.

e. COMBUSTION ANALYSIS.

Perform an "as is" combustion analysis (CO, O<sub>2</sub>, etc.) with a warmed up unit at high and low fire, if possible. In addition to data obtained from combustion analysis, also record the following:

- i. Inlet fuel pressure at burner (at high & low fire)
- ii. Draft ~~above at inlet to~~ draft hood or barometric damper
  - 1) Draft hood: high, medium, and low
  - 2) Barometric Damper: high, medium, and low
- iii. Steam pressure, water temperature, or process fluid pressure or temperature entering and leaving the boiler, steam generator, or process heater.
- iv. Unit rate if meter is available.

With above conditions recorded, make the following checks and corrective actions as necessary:

**2. CHECKS & CORRECTIONS**

a. CHECK BURNER CONDITION.

Dirty burners or burner orifices will cause boiler, steam generator, or process heater output rate and thermal efficiency to decrease. Clean burners and burner orifices thoroughly. Also, ensure that fuel filters and moisture traps are in place, clean, and operating properly, to prevent plugging of gas orifices. Confirm proper location and orientation of burner diffuser spuds, gas canes, etc. Look for any burned-off or missing burner parts, and replace as needed.

b. CHECK FOR CLEAN BOILER, STEAM GENERATOR, OR PROCESS HEATER TUBES & HEAT TRANSFER SURFACES.

External and internal build-up of sediment and scale on the heating surfaces creates an insulating effect that quickly reduces unit efficiency. Excessive fuel cost will result if the unit is not kept clean. Clean tube surfaces, remove scale and soot, assure proper process fluid flow and flue gas flow.

c. CHECK WATER TREATMENT & BLOWDOWN PROGRAM.

Soft water and the proper water or process fluid treatment must be uniformly used to minimize scale and corrosion. Timely flushing and periodic blowdown must be employed to eliminate sediment and scale build-up on a boiler, steam generator or process heater.

d. CHECK FOR STEAM, HOT WATER OR PROCESS FLUID LEAKS.

Repair all leaks immediately since even small high-pressure leaks quickly lead to considerable fuel, water and steam losses. Be sure there are no leaks through the blow-off, drains, safety valve, by-pass lines or at the feed pump, if used.

**3. SAFETY CHECKS**

a. Test primary and secondary low water level controls.

b. Check operating and limit pressure and temperature controls.

c. Check pilot safety shut off operation.

d. Check safety valve pressure and capacity to meet boiler, steam generator or process heater requirements.

e. Check limit safety control and spill switch.

4. **ADJUSTMENTS**

While taking combustion readings with a warmed up boiler, steam generator, or process heater at high fire perform checks and adjustments as follows:

- a. Adjust unit to fire at rate; record fuel manifold pressure.
- b. Adjust draft and/or fuel pressure to obtain acceptable, clean combustion at both high, medium and low fire. Carbon Monoxide (CO) value should always be below 400 parts per million (PPM) at 3% O<sub>2</sub>. If CO is high make necessary adjustments.

Check to ensure boiler, steam generator, or process heater light offs are smooth and safe. A reduced fuel pressure test at both high and low fire should be conducted in accordance with the manufacturers instructions and maintenance manuals.

- c. Check and adjust operation of modulation controller. Ensure proper, efficient and clean combustion through range of firing rates.

When above adjustments and corrections have been made, record all data.

5. **FINAL TEST**

Perform a final combustion analysis with a warmed up boiler, steam generator, or process heater at high, medium and low fire, whenever possible. In addition to data from combustion analysis, also check and record:

- a. Fuel pressure at burner (High, Medium, and Low).
- b. Draft above draft hood or barometric damper (High, Medium and Low).
- c. Steam pressure or water temperature entering and leaving boiler, steam generator, or process heater.
- d. Unit rate if meter is available.

When the above checks and adjustments have been made, record data and attach combustion analysis data to boiler, steam generator, or process heater records indicating name and signature of person, title, company name, company address and date the tuneup was performed.